


IF THE LENGTH OF THE CUL-DE-SAC IS:

- A. LESS THAN 250'-0"
THEN THE FIRE HYDRANT SHALL BE PLACED WITHIN 100'-0" OF THE CUL-DE-SAC ENTRANCE AND NO FIRE HYDRANT SHALL BE PLACED IN THE CUL-DE-SAC (SEE LOCATION A, BELOW).
- B. GREATER THAN 250'-0" BUT LESS THAN 400'-0"
THEN THE FIRE HYDRANT SHALL BE PLACED AT THE CUL-DE-SAC ENTRANCE AND NO FIRE HYDRANT SHALL BE PLACED IN THE CUL-DE-SAC (SEE LOCATION B, BELOW).
- C. GREATER THAN 400'-0"
THEN THE FIRE HYDRANT SHALL BE PLACED AT THE PROPERTY LINE (SEE LOCATION C BELOW).

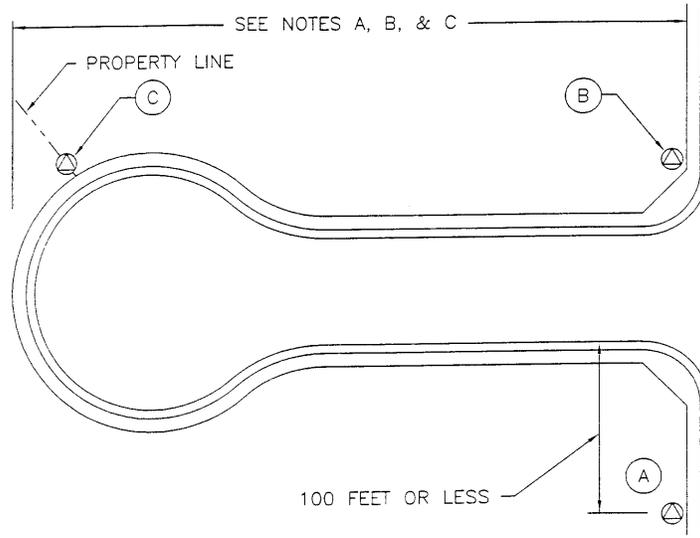

FIRE HYDRANT LOCATION ON CUL-DE-SACS

NOTES:

- 1. FIRE HYDRANTS SHALL BE LOCATED ON ALL REQUIRED ACCESS ROADWAYS AND CITY STREETS ACCORDING TO THE FOLLOWING REQUIREMENTS:
 - a) 300'-0" ON CENTER FOR ALL COMMERCIAL/INDUSTRIAL PROPERTIES.
 - b) 400'-0" ON CENTER FOR GROUP R-1 OCCUPANCIES AS DEFINED IN THE UBC (UNIFORM BUILDING CODE).
 - c) 600'-0" ON CENTER FOR GROUP R-3 OCCUPANCIES AS DEFINED IN THE UBC (UNIFORM BUILDING CODE).
- 2. DOG-LEGGED CUL-DE-SACS REQUIRE FIRE HYDRANT(S) TO BE LOCATED BY THE FIRE MARSHAL.

REV. NO.	REV. DATE	REV. BY	FIRE HYDRANT SPACING	DIGITIZED VERSION APPROVED BY CITY ENGINEER	
2	6/1/2000	HL/RH		Finbar J. O'Regan DATE: 01/09/02	
DIGITIZED	1/1/92		CITY OF STOCKTON DEPARTMENT OF PUBLIC WORKS	SUPERCEDES DWC. DATED	DRAWING NO.
DWG. BY	RC	SCALE		2/23/95	101A
CK. BY	NS	NONE			